



# PLAN VIEW

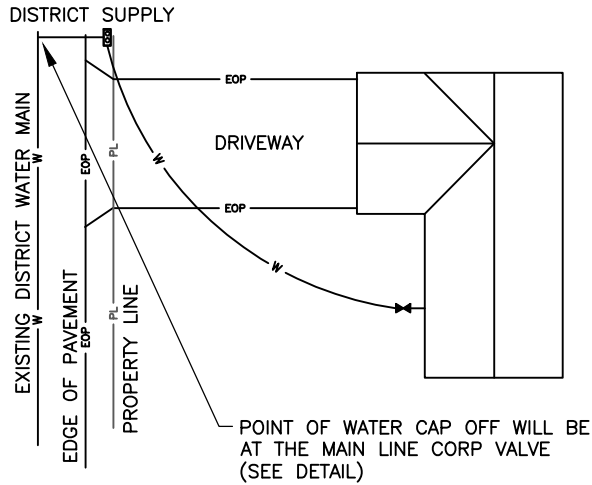

# DETAIL

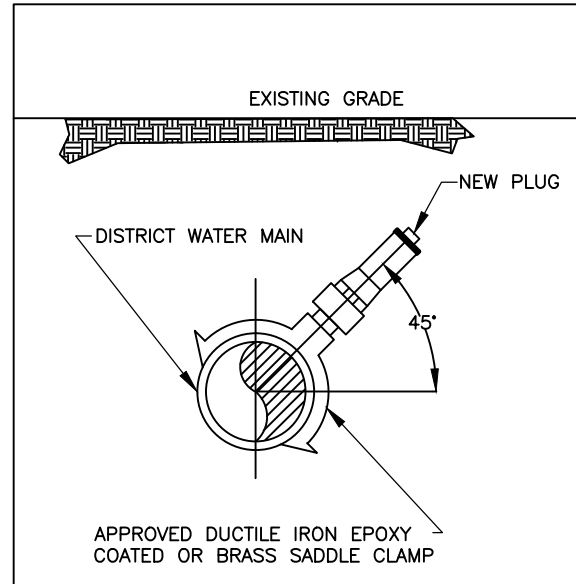

### NOTES:

- 1) UNDERGROUND SERVICE ALERT (USA) 811 TO BE NOTIFIED A MINIMUM OF FORTY EIGHT (48) HOURS BEFORE ANY EXCAVATION.
- 2) ALL WATER SERVICE(S) TO BE CAPPED SHALL BE FIELD LOCATED BY DISTRICT INSPECTORS.
- 3) DO NOT DEMOLISH ANY BUILDING UNTIL WATER SERVICE CAP OFF LOCATION FOR THAT BUILDING IS EXCAVATED AND CONFIRMED.
- 4) WATER SERVICE(S) WILL BE CAPPED AT THE MAIN LINE CORP VALVE. FINAL CAP OFF LOCATION SHALL BE FIELD VERIFIED AND APPROVED BY THE DISTRICT.
- 5) WATER SERVICE(S) MUST BE SEVERED AT THE CAP OFF POINT IN A WORKMANSHIP LIKE MANNER APPROPRIATE FOR THE TYPE OF PIPE TO BE CAPPED. A MINIMUM OF SIX FEET (6') OF PIPING DOWNSTREAM OF THE CAP OFF POINT SHALL BE REMOVED.
- 6) THE PLUGGING OF THE SEVERED WATER SERVICE(S) MUST BE MADE WITH A NEW IRON OR BRASS PLUG APPROPRIATE FOR THAT SIZE WATER SERVICE.
- 7) NO WORK SHALL BE COVERED UNTIL INSPECTED AND APPROVED BY THE DISTRICT.
- 8) THE DISTRICT SHALL BE GIVEN A MINIMUM OF TWENTY FOUR (24) HOURS NOTICE TO INSPECT ALL WORK ASSOCIATED WITH CAPPING OF LATERAL(S).

## ABANDON WATER SERVICE 3/4" TO 2"

A  
1

NO SCALE

DATE: JUL 2016  
 SCALE: NO SCALE  
 DRAWN: MAM  
 FILE: STANDARDS  
 SHEET: S4-D4

# WATER SHUT OFF & ABANDONMENT DETAILS



SOUTH TAHOE PUBLIC UTILITY DISTRICT

Sewer . 1950 . Water A PUBLIC AGENCY  
 1275 Meadow Crest Drive South Lake Tahoe, California 96150  
 Phone (530) 544-6474 Fax (530) 541-4319  
 WWW.STPUD.US